

DRAWING IS FOR REFERENCE ONLY

WHERE THE STRUCTURE IS PROPOSED OUTSIDE THE RIGHT OF WAY OR UTILITY EASEMENT



VAULT SPECIFICATIONS

WATER LINE DIAMETER	MODEL
1"	UTILITY VAULT 3030-LA (OR EQUAL)
1-1/2" - 2"	UTILITY VAULT 3642-PUT (OR EQUAL)

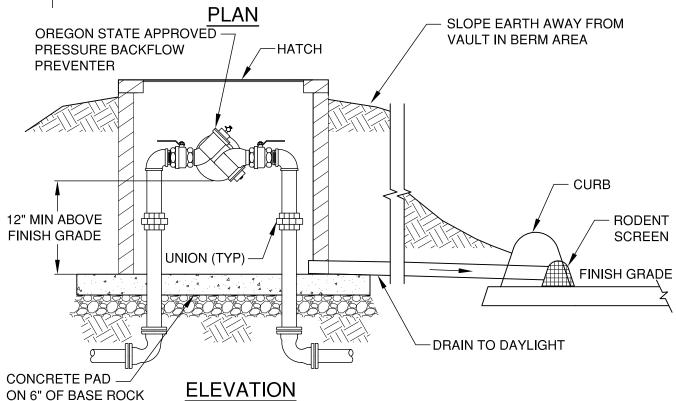

NOTES:

- 1. THIS DRAWING IS FOR REFERENCE ONLY. INSTALL PER PLUMBING CODE AND BUILDING DEPARTMENT REQUIREMENTS.
- 2. REDUCED PRESSURE BACKFLOW ASSEMBLY TO BE LOCATED DIRECTLY DOWN STREAM OF WATER METER
- 3. BRASS, STAINLESS, OR PLASTIC PLUGS TO BE INSTALLED IN TEST COCKS IF BELOW GROUND INSTALLATION
- 4. HIGH OR LOW HAZARD CONNECTIONS SHALL BE IDENTIFIED AND VERIFIED WITH CITY CROSS CONNECTION SPECIALIST

		CITY OF BEND	1"-2" REDUCED PRESSURE BACKFLOW ASSEMBLY	STD DWG W-15A
			710 NW WALL ST., BEND, OREGON 97701	APPR
REV	DATE	OATE ((H-III))	STANDARD DRAWING	DATE 12/1/17
DIV	WATER	arna		
DRAW	™ LJC		CITY OF BEND	SCALE NTS